

The Lotis Engineering Group, P.C.

6465 Transit Road – Suite 23
East Amherst, New York 14051-2232
716.276.8707

December 5, 2016

Jamie Phillips
Lancaster Central School District
177 Central Avenue
Lancaster, New York 14086

Re: Lead Testing in School Drinking Water
Lancaster District Offices
177 Central Ave,
Lancaster, NY 14086

Dear Ms. Phillips:

On September 6, 2016, Governor Andrew M. Cuomo signed legislation (S.8158/A.10740) mandating that public schools in New York State test potable water for lead contamination. The New York State Department of Health (NYSDOH) also issued emergency regulations pursuant to the new legislation (NYCRR Title X, Subpart 67-4).

In accordance with the new law and regulations, Lancaster Central School District (District) contracted The Lotis Engineering Group, P.C. (Lotis), to complete water testing in all District buildings. This submission summarizes the analytical results of sampling completed on October 22, 2016 at the Lancaster District Offices.

Maintenance closets and showers are not required to be tested under the new state mandates and were not included under this scope of work. Per the emergency regulations issued by the NYSDOH, first-draw samples were collected from cold water outlets after water lay motionless in the pipes for a minimum of 8 hours, but not more than 18 hours. The school district was responsible for flushing outlets at least 8 hours prior to sample collection. Lotis was notified by the school district that flushing was completed over 8 hours prior to sampling. However, this could not be independently verified by Lotis.

Samples were collected by placing a sterile container under each outlet and turning on the water source, allowing Lotis to collect a first-draw cold water sample. Samples were collected in clean 250 mL containers containing the appropriate nitric acid preservative, as provided by the testing laboratory. Samples were then delivered to Microbac Laboratories (a certified Environmental Laboratory Approved Program) following standard chain of custody protocols.

A total of 14 outlets were sampled inside the building. To Lotis' knowledge, these represent every outlet within the building to which students and staff have regular access.

The Lotis Engineering Group, P.C.

6465 Transit Road – Suite 23
East Amherst, New York 14051-2232
716.276.8707

At the Lancaster District Offices, 1 sample exceeded the 15 parts per billion (ppb) action level set forth by the NYSDOH. A summary of these samples is included in the following table:

Table 1 – Samples Exceeding 15 ppb

| Sample ID | Location Details | Results (ppb) |
|-----------------|------------------------|---------------|
| 12-OMD-Maint-S1 | Maintenance Room- Sink | 60.2 |

Included in this submission are the complete laboratory analytical reports, chain of custody logs and photos of sample locations that exceeded the action levels.

In accordance with the new legislation, use of the aforementioned outlets is prohibited until a lead remediation plan is implemented and new testing demonstrates that the resulting lead levels are below 15 ppb. Alternative water supplies may be necessary in impacted areas. The legislation requires that Lancaster Central School District provide these results to the NYSDOH within one business day of receipt. Further, notification to building staff, all persons in parental relation to students, the local health department and the State Education Department is required within 10 business days of receipt of these results. These results and any associated remedial plans must be posted on the District's website within six weeks of receipt and all records must be retained by the District for at least 10 years.

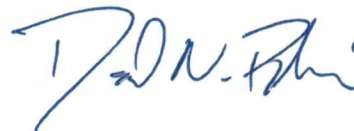
The NYSDOH recommends reviewing "3Ts for Reducing Lead in Drinking Water in Schools, Revised Technical Guidance" published by the United States Environmental Protection Agency (USEPA) to assist schools in assessing an appropriate remediation plan. A copy of this publication can be reviewed through the following hyperlink [3Ts for Reducing Lead in Drinking Water in Schools](#).

Lotis is available at your convenience to discuss this issue further.

Sincerely,



Kelly Reidy
Environmental Scientist



David N. Robinson, P.E.
President/CEO



November 22, 2016

The Lotis Engineering Group, P.C.
6465 Transit Road - Suite 23
East Amherst, NY 14051-2232

Work Order No.: 16K0144

Re: Lancaster District Office

Dear Kelly Reidy:

Microbac Laboratories, Inc. - Chicagoland Division received 15 sample(s) on 10/28/2016 3:20:59PM for the analyses presented in the following report as Work Order 16K0144.

The enclosed results were obtained from and are applicable to the sample(s) as received at the laboratory. All sample results are reported on an "as received" basis unless otherwise noted.

All data included in this report have been reviewed and meet the applicable project specific and certification specific requirements, unless otherwise noted. A qualifications page is included in this report and lists the programs under which Microbac maintains certification.

This report has been paginated in its entirety and shall not be reproduced except in full, without the written approval of Microbac Laboratories.

We appreciate the opportunity to service your analytical needs. If you have any questions, please contact your project manager. For any feedback, please contact Robert Crookston, Managing Director, at robert.crookston@microbac.com.

Sincerely,
Microbac Laboratories, Inc.

A handwritten signature in blue ink, appearing to read 'Ron Misiunas', with a stylized flourish at the end.

Ron Misiunas
Director of Laboratory Services

[Microbac Laboratories, Inc.](http://www.microbac.com)

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

Laboratory Analytical Results

**WORK ORDER SAMPLE SUMMARY****Date:** Tuesday, November 22, 2016**Client:** The Lotis Engineering Group, P.C.**Project:** Lancaster District Office**Lab Order:** 16K0144

| Lab Sample ID | Client Sample ID | Tag Number | Collection Date | Date Received |
|---------------|------------------------|---------------------|------------------|----------------------|
| 16K0144-02 | 1-DO-SA-S1 | SA=Staff Area | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-03 | 2-DO-Base-MBR-S1 | MBR=Men's bathroom | 10/22/2016 09:08 | 11/2/2016 11:53:32AM |
| 16K0144-04 | 3-DO-Base-LBR-S1 | LBR=Ladies Bathroom | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-05 | 4-DO-ML-BF1 | ML=Main Lobby BF=Bc | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-06 | 5-DO-ML-WF1 | | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-07 | 6-DO-Super Office - S1 | | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-08 | 7-DO-2HW-WF1 | | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-09 | 8-DO-2BR-S1 | | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-10 | 9-DO-2HW-BF1 | | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-11 | 10-OMB-Maint-WF | | 10/22/2016 09:20 | 11/2/2016 11:53:32AM |
| 16K0144-12 | 11-OMB-MBR-S1 | | 10/22/2016 09:18 | 11/2/2016 11:53:32AM |
| 16K0144-13 | 12-OMD-Maint-S1 | | 10/22/2016 09:21 | 11/2/2016 11:53:32AM |
| 16K0144-14 | 13-DO-MO-S1 | | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |
| 16K0144-15 | 14-MO-BBR-S1 | by MO | 10/22/2016 09:10 | 11/2/2016 11:53:32AM |

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com



Analytical Results

Date: Tuesday, November 22, 2016

Client: The Lotis Engineering Group, P.C.
Client Project: Lancaster District Office

Work Order: 16K0144
Received: 11/02/2016 11:53

| Analyses | Certs | Result | Units | Qual | Analyzed | Tech | Method |
|---|--------|--------|-------|------|------------------|------|-----------------------------|
| 02 1-DO-SA-S1 - SA=Staff Area | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | 5.24 | ug/L | | 11/21/2016 17:27 | RPL | EPA 200.8 Rev 5.4 |
| 03 2-DO-Base-MBR-S1 - MBR=Men's bathroom | | | | | | | Collected: 10/22/2016 09:08 |
| Lead | gdmnoi | 7.90 | ug/L | | 11/21/2016 17:28 | RPL | EPA 200.8 Rev 5.4 |
| 04 3-DO-Base-LBR-S1 - LBR=Ladies Bathroom | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | 1.72 | ug/L | | 11/21/2016 17:30 | RPL | EPA 200.8 Rev 5.4 |
| 05 4-DO-ML-BF1 - ML=Main Lobby BF=Bottle Filler | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | < 1.00 | ug/L | | 11/21/2016 17:31 | RPL | EPA 200.8 Rev 5.4 |
| 06 5-DO-ML-WF1 | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | < 1.00 | ug/L | | 11/21/2016 17:32 | RPL | EPA 200.8 Rev 5.4 |
| 07 6-DO-Super Office - S1 | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | 10.3 | ug/L | | 11/21/2016 17:33 | RPL | EPA 200.8 Rev 5.4 |
| 08 7-DO-2HW-WF1 | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | < 1.00 | ug/L | | 11/21/2016 17:34 | RPL | EPA 200.8 Rev 5.4 |
| 09 8-DO-2BR-S1 | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | 1.41 | ug/L | | 11/21/2016 17:38 | RPL | EPA 200.8 Rev 5.4 |
| 10 9-DO-2HW-BF1 | | | | | | | Collected: 10/22/2016 09:10 |
| Lead | gdmnoi | < 1.00 | ug/L | | 11/21/2016 17:39 | RPL | EPA 200.8 Rev 5.4 |
| 11 10--OMB-Maint-WF | | | | | | | Collected: 10/22/2016 09:20 |
| Lead | gdmnoi | < 1.00 | ug/L | | 11/21/2016 17:40 | RPL | EPA 200.8 Rev 5.4 |

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com



Analytical Results

Date: Tuesday, November 22, 2016

12 11-OMB-MBR-S1

Collected: 10/22/2016 09:18

Lead gdmnoi 2.05 ug/L 11/21/2016 17:42 RPL EPA 200.8 Rev 5.4

13 12-OMD-Maint-S1

Collected: 10/22/2016 09:21

Lead gdmnoi 60.2 ug/L 11/21/2016 17:43 RPL EPA 200.8 Rev 5.4

14 13-DO-MO-S1

Collected: 10/22/2016 09:10

Lead gdmnoi < 1.00 ug/L 11/21/2016 17:44 RPL EPA 200.8 Rev 5.4

15 14-MO-BBR-S1 - by MO

Collected: 10/22/2016 09:10

Lead gdmnoi 4.55 ug/L 11/21/2016 17:45 RPL EPA 200.8 Rev 5.4

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com



FLAGS, FOOTNOTES AND ABBREVIATIONS (as needed)

B = Detected in the associated method Blank at a concentration above the routine RL
b- = Detected in the associated method Blank at a concentration greater than 2.2 times the MDL
b* = Detected in the associated method Blank at a concentration greater than half the RL
CFU = Colony forming units
D = Dilution performed on sample
DF = Dilution Factor
g = Gram
E = Value above quantitation range
H = Analyte was prepared and/or analyzed outside of the analytical method holding time
I = Matrix Interference
J = Analyte concentration detected between RL and MDL (Metals / Organics)
LOD = Limit of Detection
LOQ = Limit of Quantitation
m3 = Meters cubed
MDL = Method Detection Limit
mg/Kg = Milligrams per Kilogram (ppm)
mg/L = Milligrams per Liter (ppm)
NA = Not Analyzed
ND = Not Detected at the Reporting Limit (or the Method Detection Limit, if used)
NR = Not Recovered
R = RPD outside accepted recovery limits
RL = Reporting Limit
S = Spike recovery outside recovery limits
Surr = Surrogate
U = Undetected
> = Greater than
< = Less than
% = Percent
* = Result exceeds project specific limits

ANALYTE TYPES: (AT)

A,B = Target Analyte
I = Internal Standard
M = Summation Analyte
S = Surrogate
T = Tentatively Identified Compound (TIC, concentration estimated)

QC SAMPLE IDENTIFICATIONS

| | |
|---------------------------------------|---|
| BLK = Method Blank | ICSA = Interference Check Standard "A" |
| DUP = Method Duplicate | ICSAB = Interference Check Standard "AB" |
| BS = Method Blank Spike | BSD = Method Blank Spike Duplicate |
| MS = Matrix Spike | MSD = Matrix Spike Duplicate |
| ICB = Initial Calibration Blank | ICV = Initial Calibration Verification |
| CCB = Continuing Calibration Blank | CCV = Continuing Calibration Verification |
| CRL = Client Required Reporting Limit | OPR = Ongoing Precision and Recovery Standard |
| PDS = Post Digestion Spike | SD = Serial Dilution |
| QCS = Quality Control Standard | |

CERTIFICATIONS (Certs)

Below is a list of certifications maintained by the Microbac Merrillville Laboratory. All data included in this report has been reviewed for and meets all project specific and quality control requirements of the applicable accreditation, unless otherwise noted. Complete lists of individual analytes pursuant to each certification below are available upon request.

- ^d Illinois EPA drinking water, wastewater and solid waste analysis (#200064)
- ^g Indiana SDH chemical analysis of drinking water (#C-45-03)
- ⁱ Kansas Dept Health & Env. NELAP (#E-10397)
- ^m New York State Department of Health Wadsworth (#12006)
- ⁿ Pennsylvania Department of Environmental Protection (#68-04863)
- ^o Virginia Department of General Services Division of Consolidated Laboratory Services (#7990)

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com



COOLER INSPECTION

Client Name: The Lotis Engineering Group, P.C.

Date: Tuesday, November 22, 2016

Date/Time Received: 10/28/2016 15:20

Work Order Number: 16K0144

Received by: Nicole Rainwater

Checklist completed by: 11/2/2016 11:53:31AM | Nicole Rainwater

Reviewed by: 11/4/2016 | KAZ

Carrier Name: Client Delivered

Cooler ID: Default Cooler

Container/Temp Blank Temperature: 21.5° C

| | | | | | |
|---|-----|-------------------------------------|----|-------------------------------------|---|
| After-Hour Arrival? | Yes | <input type="checkbox"/> | No | <input checked="" type="checkbox"/> | |
| Shipping container/cooler in good condition? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | Not Present <input type="checkbox"/> |
| Custody seals intact on shipping container/cooler? | Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | Not Present <input checked="" type="checkbox"/> |
| Custody seals intact on sample containers? | Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | Not Present <input checked="" type="checkbox"/> |
| COC present? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC included sufficient client identification? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC included sufficient sample collector information? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC included a sample description? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC agrees with sample labels? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC identified the appropriate matrix? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC included date of collection? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC included time of collection? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC identified the appropriate number of containers? | Yes | <input type="checkbox"/> | No | <input checked="" type="checkbox"/> | |
| Samples in proper container/bottle? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| Sample containers intact? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| Sufficient sample volume for indicated test? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| All samples received within holding time? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| If the samples are preserved, are the preservatives identified? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |

If No, adjusted by? _____

| | | | | | |
|--|-----|-------------------------------------|----|-------------------------------------|--|
| COC included the requested analyses? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| COC signed when relinquished and received? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| Samples received on ice? | Yes | <input type="checkbox"/> | No | <input checked="" type="checkbox"/> | |
| Samples properly preserved? | Yes | <input checked="" type="checkbox"/> | No | <input type="checkbox"/> | |
| Voa vials for aqueous samples have zero headspace? | Yes | <input type="checkbox"/> | No | <input type="checkbox"/> | No VOA vials submitted <input checked="" type="checkbox"/> |

Cooler Comments:

ANY "NO" EVALUATION (excluding After-Hour Receipt) REQUIRES CLIENT NOTIFICATION.

Microbac Laboratories, Inc.

250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

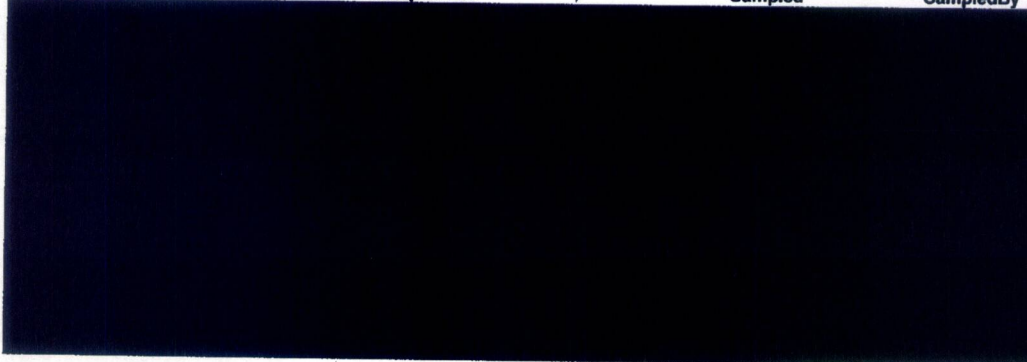


| Sample ID | Client Sample ID | Comments |
|------------|------------------------|----------|
| 16K0144-01 | Example Sample | |
| 16K0144-02 | 1-DO-SA-S1 | |
| 16K0144-03 | 2-DO-Base-MBR-S1 | |
| 16K0144-04 | 3-DO-Base-LBR-S1 | |
| 16K0144-05 | 4-DO-ML-BF1 | |
| 16K0144-06 | 5-DO-ML-WF1 | |
| 16K0144-07 | 6-DO-Super Office - S1 | |
| 16K0144-08 | 7-DO-2HW-WF1 | |
| 16K0144-09 | 8-DO-2BR-S1 | |
| 16K0144-10 | 9-DO-2HW-BF1 | |
| 16K0144-11 | 10--OMB-Maint-WF | |
| 16K0144-12 | 11-OMB-MBR-S1 | |
| 16K0144-13 | 12-OMD-Maint-S1 | |
| 16K0144-14 | 13-DO-MO-S1 | |
| 16K0144-15 | 14-MO-BBR-S1 | |

Microbac Laboratories, Inc.

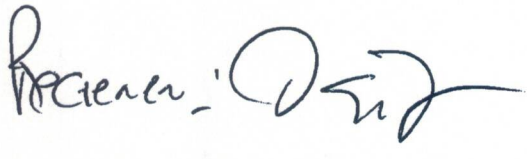
250 West 84th Drive | Merrillville, IN 46410 | 800.536.8379 p | 219.769.8378 p | 219.769.1664 f | www.microbac.com

16K0144

| SampleID | Matrix | SampleName | SampleAlias | Sampled | SampledBy |
|----------|---------|--|-------------|---------|-----------|
| 1 | Aqueous |  | | | |
| 2 | Aqueous | | | | |
| 3 | Aqueous | | | | |
| 4 | Aqueous | | | | |
| 5 | Aqueous | | | | |
| 6 | Aqueous | | | | |
| 7 | Aqueous | | | | |
| 8 | Aqueous | | | | |
| 9 | Aqueous | | | | |
| 10 | Aqueous | | | | |
| 11 | Aqueous | | | | |
| 12 | Aqueous | | | | |
| 13 | Aqueous | | | | |
| 14 | Aqueous | | | | |
| 15 | Aqueous | | | | |

01
15

Ref: 

Receiv:  10/28/16 1520

NT 22.0
-0.5
21.5°C



| Sampl Matr | SampleName | SampleAlias | Sampled | SampledBy |
|------------|-----------------------------|--------------------------------|------------------|-------------|
| 1 | Aque 1-DO-SA-S1 | SA=Staff Area | 10/22/2016 09:10 | Kelly Reidy |
| 2 | Aque 2-DO-Base-MBR-S1 | MBR=Men's bathroom | 10/22/2016 09:08 | Kelly Reidy |
| 3 | Aque 3-DO-Base-LBR-S1 | LBR=Ladies Bathroom | 10/22/2016 09:10 | Kelly Reidy |
| 4 | Aque 4-DO-ML-BF1 | ML=Main Lobby BF=Bottle Filler | 10/22/2016 09:10 | Kelly Reidy |
| 5 | Aque 5-DO-ML-WF1 | | 10/22/2016 09:10 | Kelly Reidy |
| 6 | Aque 6-DO-Super Office - S1 | | 10/22/2016 09:10 | Kelly Reidy |
| 7 | Aque 7-DO-2HW-WF1 | | 10/22/2016 09:10 | Kelly Reidy |
| 8 | Aque 8-DO-2BR-S1 | | 10/22/2016 09:10 | Kelly Reidy |
| 9 | Aque 9-DO-2HW-BF1 | | 10/22/2016 09:10 | Kelly Reidy |
| 10 | Aque 10--OMB-Maint-WF | | 10/22/2016 09:20 | Kelly Reidy |
| 11 | Aque 11-OMB-MBR-S1 | | 10/22/2016 09:18 | Kelly Reidy |
| 12 | Aque 12-OMD-Maint-S1 | | 10/22/2016 09:21 | Kelly Reidy |
| 13 | Aque 13-DO-MO-S1 | | 10/22/2016 09:10 | Kelly Reidy |
| 14 | Aque 14-MO-BBR-S1 | by MO | 10/22/2016 09:10 | Kelly Reidy |

Lancaster District Office